



NOTES:

- 1) ZONES IDENTICAL ON EITHER SIDE OF THE CENTERLINE AS SHOWN BELOW
- 2) REQUIREMENTS OF THE STATE OF CALIFORNIA, HEALTH AND WELFARE AGENCY, DEPARTMENT OF HEALTH SERVICES
- 3) SEE STD NO. 31 FOR NOTES ON WATER, RECYCLED WATER AND SEWER MAIN PARALLEL AND PERPENDICULAR SEPARATIONS
- 4) REFER TO THE NMWD STANDARDS SPECIFICATION 15151 FOR PIPE SEPARATION REQUIREMENTS

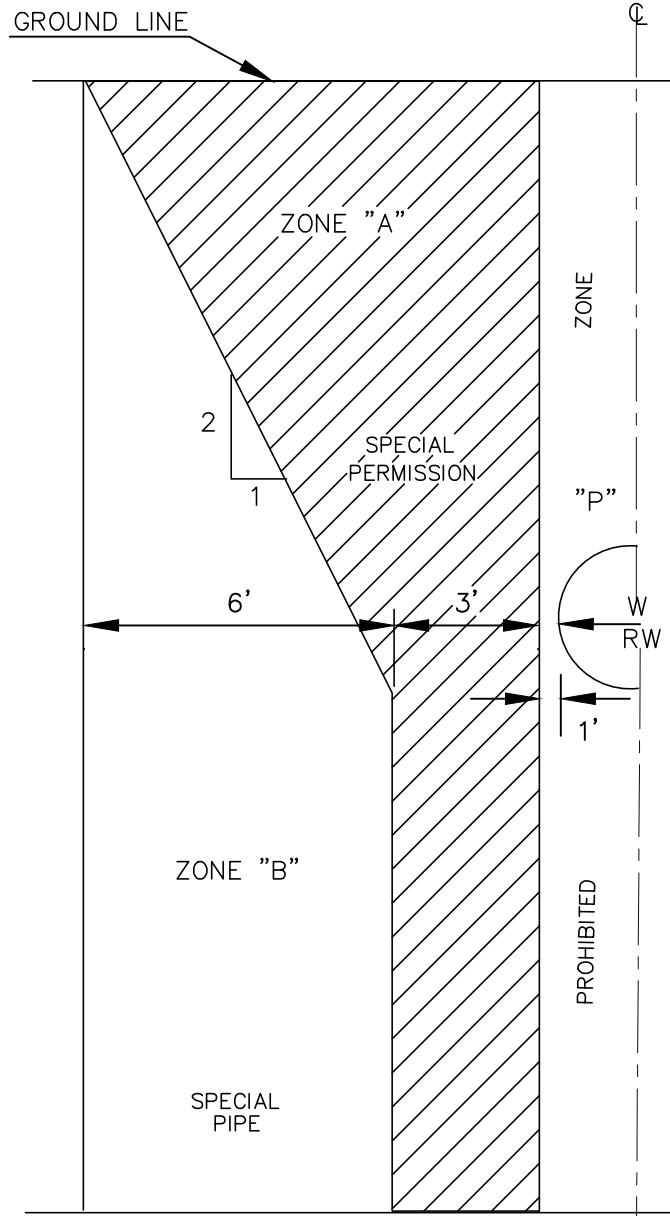

CASE 1
 NEW RECYCLED WATER
 OR
 NEW SEWER

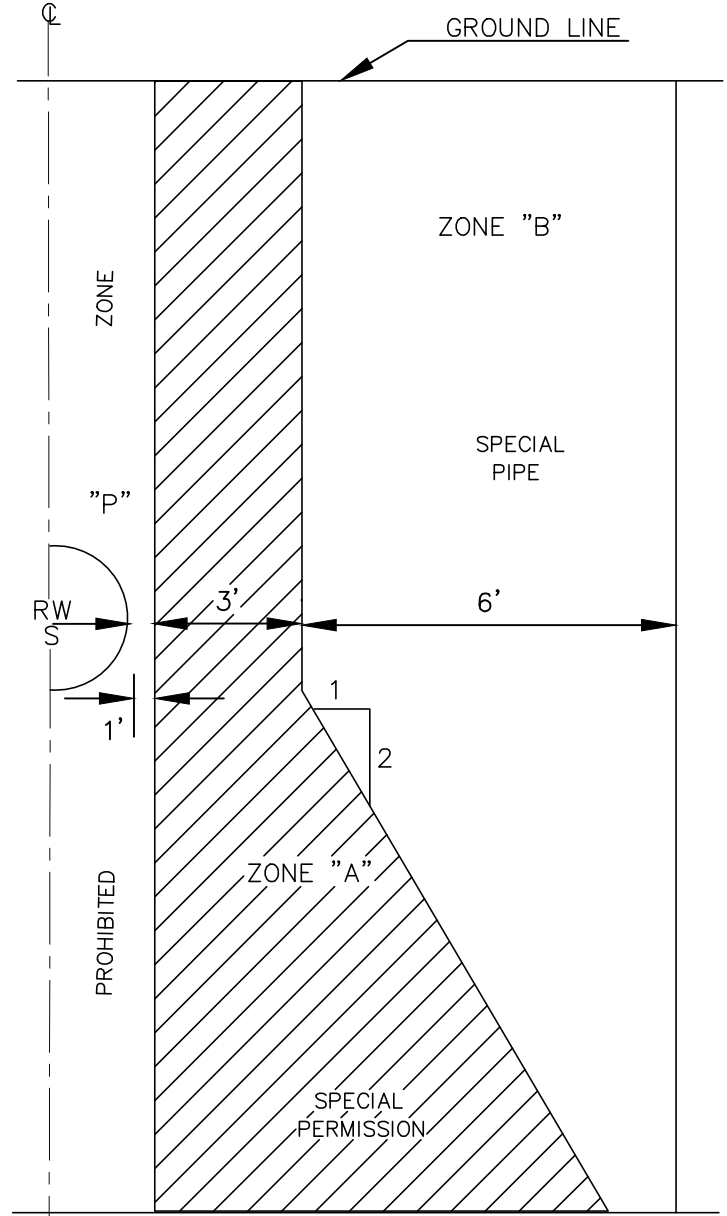

CASE 2
 NEW POTABLE WATER
 OR
 NEW RECYCLED WATER



WATER, RECYCLED WATER AND SEWER MAIN PARALLEL SEPARATIONS

APPROVED	DATE	REV	STD NO
<i>[Signature]</i>	12/28/10	0	29