


PLAN

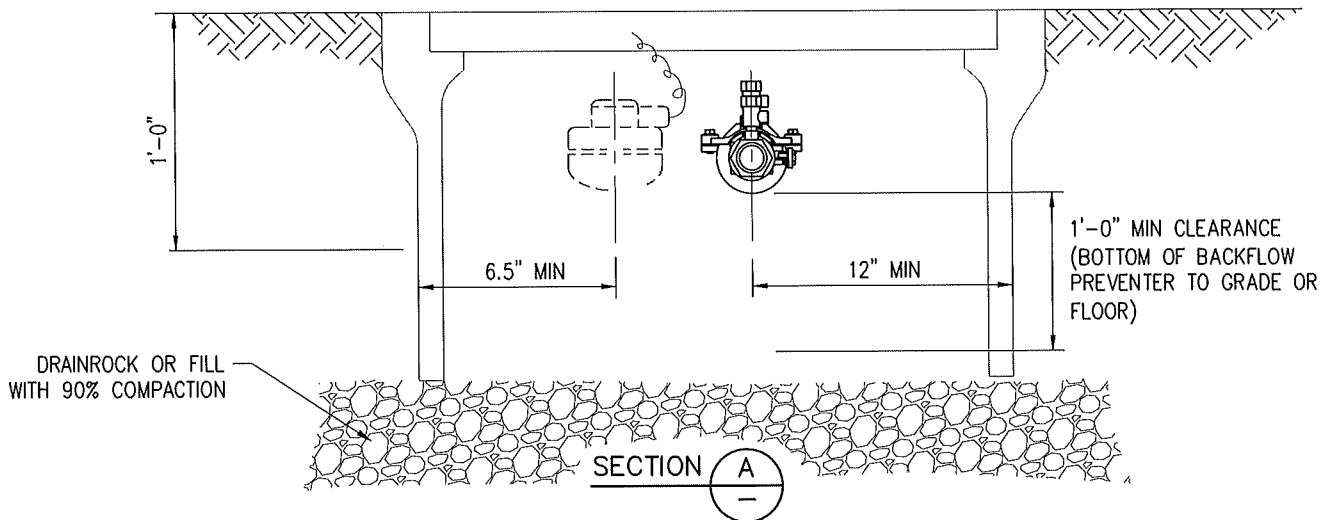

SECTION A

PARTS LIST		METER SIZE	
1	METER COUPLING (BRASS)	3/4"	1"
2	90° ELBOW (BRASS)	3/4"	1"
3	LONG NIPPLE (BRASS)	6" LONG	6" LONG
4	NIPPLE (BRASS)	3" LONG	N/A
5	DOUBLE CHECK BACKFLOW PREVENTER (WILKINS 350XL OR APPROVED EQUAL)		
6	CLOSE NIPPLE (BRASS)	1 1/2" LONG	2" LONG
7	BUSHING (BRASS)	3/4"x1"	1"x1-1/4"

NOTES:

1. THIS STANDARD HAS BEEN DISCONTINUED AND IS FOR REFERENCE ONLY.
2. CUSTOMER MUST ENSURE THE UNIT IS ACCESSIBLE FOR TESTING AT ALL TIMES.
3. FOR WATER SERVICE INSTALLATION REFER TO NMWD STD 15.
4. BELOW GRADE BACKFLOW PREVENTER ASSEMBLY IS INSTALLED BY NMWD. REFER TO NMWD TECHNICAL SPECIFICATION 15112.

NORTH MARIN WATER DISTRICT NOVATO, CALIFORNIA			
BELOW GRADE BACKFLOW PREVENTER 3/4" AND 1"			
APPROVED	DATE	REV.	STD. NO.
	03/24/22	4	18

THIS STANDARD HAS BEEN DISCONTINUED