



ITEM	DESCRIPTION	QUANTITY
A	NIPPLE/PIPE - FIELD FIT	2
B	90° ELBOW	2
C	NIPPLE/PIPE - FIELD FIT	2
D	UNION FEMALE (NOT REQUIRED IF USING COPPER)	2
E	6" NIPPLE (NOT REQUIRED IF USING COPPER)	2
F	90° STREET ELBOW	2
G	BACKFLOW PREVENTION ASSEMBLY - WILKINS 975XL2 OR APPROVED EQUAL (SEE NOTE 1)	1
H	CONCRETE PAD PER NMWD STD SPECIFICATION 03300	1

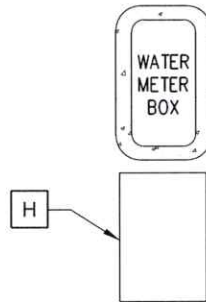

CONCRETE PAD LAYOUT
(ASSEMBLY INLINE WITH METER)



CONCRETE PAD LAYOUT
(ASSEMBLY AT 90° TO METER)

NOTES:

- REFER TO SPECIFICATION SECTION 15112 FOR BACKFLOW REQUIREMENTS.
- NO OUTLET, TAP, TEE OR ANY OTHER TYPE OF CONNECTIONS WILL BE ALLOWED BETWEEN THE METER AND THE ASSEMBLY.
- THE ASSEMBLY SHALL BE INSTALLED AS CLOSE TO THE METER AS POSSIBLE.
- INSPECTION BY THE DISTRICT SHALL TAKE PLACE PRIOR TO ANY BACKFILL.
- ASSEMBLY SHALL BE ACCESSIBLE TO THE DISTRICT FOR TESTING.
- ALL ABOVE GROUND MATERIAL SHALL BE BRASS OR TYPE K COPPER.
- ALL INSTALLS SHALL BE LEVEL, PLUMB AND TRUE.
- CONCRETE PAD SHALL BE A MINIMUM WIDTH OF THE METER BOX. ASSEMBLY SHALL BE CENTERED ON CONCRETE PAD.
- ENCLOSURE CAGE OR INSULATION BLANKET IS OPTIONAL.
- ALL ASSEMBLIES WILL BE OWNED FROM CUSTOMER SIDE OF THE METER AS SHOWN.

NOT TO SCALE

NORTH MARIN WATER DISTRICT NOVATO, CALIFORNIA			
ABOVE GRADE REDUCED PRESSURE PRINCIPAL BACKFLOW PREVENTION ASSEMBLY 3/4" THROUGH 2"			
APPROVED <i>[Signature]</i>	DATE 02/02/23	REV. 1	STD. NO. 19A